
CONCRETE PRODUCT NOTE:

1. REFER TO GENERAL TOLERANCES UNO
2. GRADE OF CONCRETE - CONCRETE 40MPA
3. ALL LIFTING POINTS TO BE USED WHEN LIFTING
4. MINIMUM STRENGTH OF CONCRETE SHALL BE 25MPA AT


THE TIME OF LIFTING

5. COVER TO REINFORCEMENT TO BE 50mm
6. REFER TO ANCON LIFTING ARRANGEMENT PLAN
7. CONCRETE VOLUME (M³) = [0.2]


	BOM:50201491_									
ITEM #	QTY	PART #	DESCRIPTION	MATERIAL	VOLUME					
1	1	50201265	CONCRETE 40MPA	CONCRETE 40MPA	0.20					
2	1	50201091	ASSEMBLY MANHOLE FRAME AND COVER 2 PART	CAST IRON						
3	4	50201274	FOOT ANCHOR GALV 1.3Tx65mm	MS GR-250 GALV						

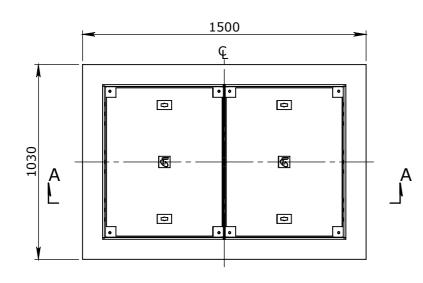







SECTION A-A

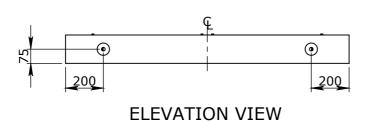

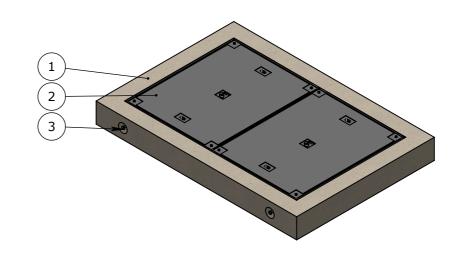

ISOMETRIC VIEW



SECTION B-B



END VIEW

TOLERANCE NOTES:

1. CONCRETE TOLERANCES TO BE
 INCONJUCTION / ACCORDANCE WITH
 AS3600 - CONCRETE STRUCTURES

2. WHEN A BROOM FINISH IS REQUIRED THE
 GENERAL TOLERANCE SUPERCEDES THE
 FLATNESS TOLERANCE

3. WALL THICKNESS - DIMENSION AS NOTED
 IS MINIMUM THICKNESS ONLY

4. CONCRETE GRADE - 40MPA UNLESS NOTED
 OTHERWISE 2 CONCRETE GRADE - 40-1174 ONLESS 113 OTHERWISE
 DIMENSIONS ARE NOT INCLUSIVE OF
 SEALANTS OF JOINTS
 SURFACE FINISH - CLASS 4 (AS3610.1)

Rev. DESCRIPTION DATE BY APPROVED REVISION CONTROL **GENERAL TOLERANCES** NOMINAL: FLATNESS: (NOT INCLUDING BROOME FINISH) 1M AND ABOVE UP TO 1000mm ±4mm PER 1M WIDTH 1mm IN 200mm UP TO A MAXIMUM OF 20mm TOLERANCE:

RPEQ DOCUMENT #: 375Kg CONCRETE 40MPA

Infrastructure Products Australia A CRH COMPANY

1 REEVES COURT

91 STRADBROKE STREET BREAKWATER, VIC 3219 HEATHWOOD, QLD 4110

	DRAFTED DATE:	PART/PRODUCT #	QUOTE	Ε#	ORDER #			
	27/05/2022	50201491						
	DRAFTED BY:	REINFORCEMENT COMPUTATION		PIT #		ITEM TYPE		
DATE LAST SAVED: CLIENT								
	27/05/2022 LAST SAVED BY:	22 CUBIS SYSTEMS/AUS PITS						
	MLEE							
	⊕ [-]	PIT CONCRETE MANHOLE TURRET 150MM						
0	DRAWN TO AS 1100	DRAWING #	PAGE :	SHEET SIZE	SCALE	Δ		
J	DO NOT SCALE FROM SHEET	50201491	1 / 1	Α3	1:20	• •		

IN 1M LENGTH