



CONCRETE NOTE:


1. REFER TO GENERAL TOLERANCES UNO
2. GRADE OF CONCRETE - 40MPa
3. MINIMUM STRENGTH OF CONCRETE SHALL BE 25MPa AT THE TIME OF LIFTING

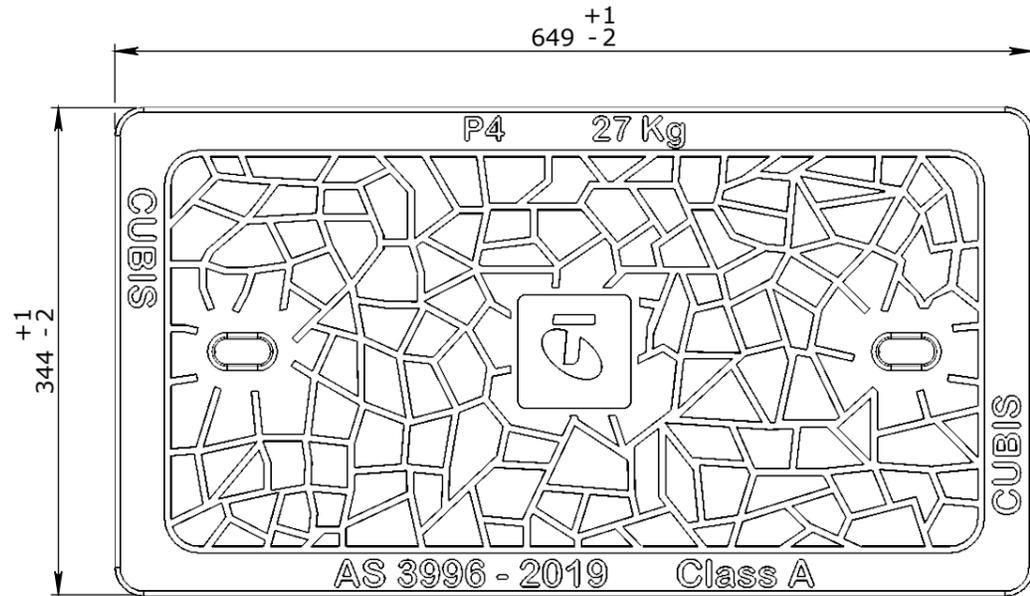


PLAN VIEW

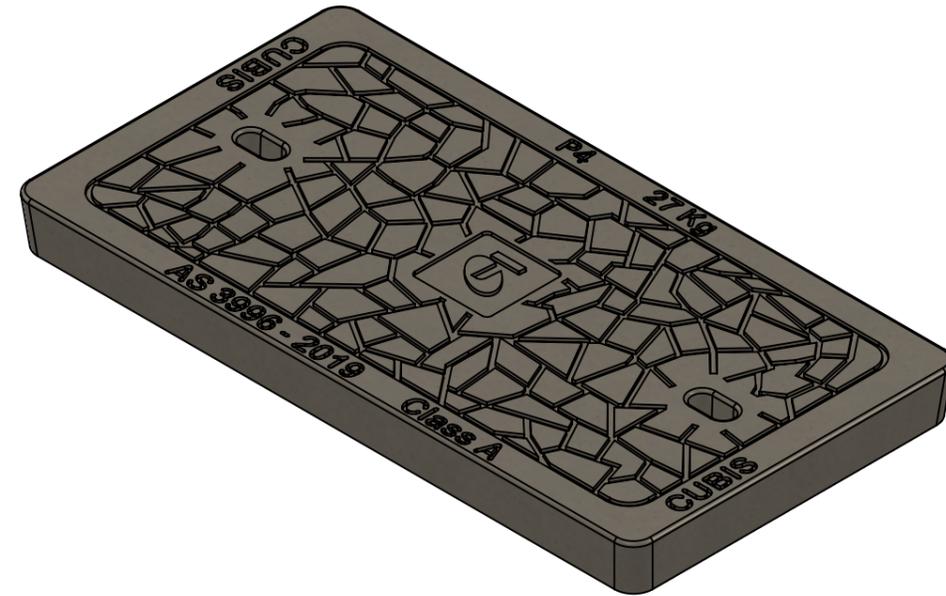

ISOMETRIC VIEW

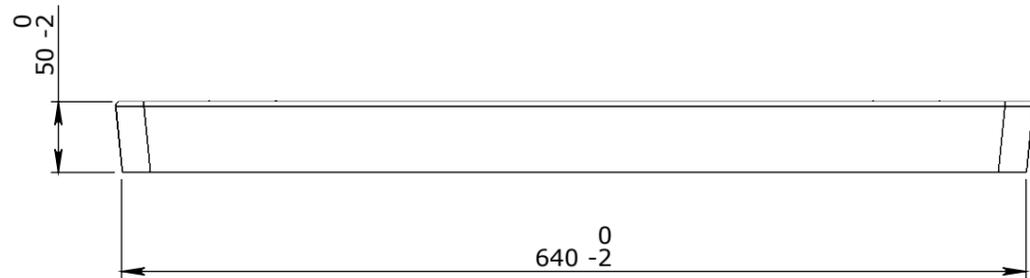

ELEVATION VIEW

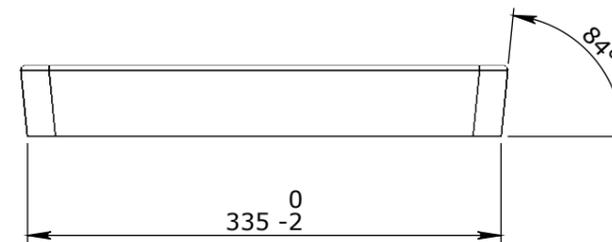

END VIEW

- TOLERANCE NOTES:**
1. CONCRETE TOLERANCES TO BE IN CONJUNCTION / ACCORDANCE WITH AS3600 - CONCRETE STRUCTURES
 2. WHEN A BROOME FINISH IS REQUIRED THE GENERAL TOLERANCE SUPERCEEDS THE FLATNESS TOLERANCE
 3. WALL THICKNESS - DIMENSION AS NOTED IS MINIMUM THICKNESS ONLY
 4. CONCRETE GRADE - 40MPa UNLESS NOTED OTHERWISE
 5. DIMENSIONS ARE NOT INCLUSIVE OF SEALANTS OF JOINTS
 6. SURFACE FINISH - CLASS 4 (AS3610.1)

| Rev | DESCRIPTION | DATE | BY | APPROVED |
|-----|-------------|------|----|----------|
| 3 | | | | |
| 2 | | | | |
| 1 | | | | |

| GENERAL TOLERANCES | | REVISION CONTROL | |
|--------------------|--------------|--------------------------------------|---|
| NOMINAL: | UP TO 1000mm | 1M AND ABOVE | FLATNESS: (NOT INCLUDING BROOME FINISH) |
| TOLERANCE: | ±5mm | 1mm IN 200mm UP TO A MAXIMUM OF 20mm | ±4mm PER 1M WIDTH IN 1M LENGTH |

| | |
|------------------|----------------|
| CHK / APPR: | CA |
| DATE: | 27/09/2019 |
| RPEQ DOCUMENT #: | |
| WEIGHT: | 27Kg |
| MATERIAL: | CONCRETE 40MPa |



HEAD OFFICE:
CARNINGHAM ROAD
BALLARAT, VIC 3351
(03) 5335 8741

ENGINEERING & DEVELOPMENT:
2 STRADBROKE STREET
HEATHWOOD, QLD 4110
(07) 3714 0444

| | |
|--|------------|
| DRAFTED DATE: | 19/09/2019 |
| DRAFTED BY: | YJ SHAN |
| DATE LAST SAVED: | 27/09/2019 |
| LAST SAVED BY: | ChanakaA |
| | |
| DRAWN TO AS 1100 DO NOT SCALE FROM SHEET | |

| | | | |
|---------------------------|-----------------------------------|------------|-------|
| PROJECT: | CUBIS SYSTEMS CATALOGUE | | |
| | CONCRETE COVER | | |
| | P4 TELSTRA CLASS A | | |
| NAME: | CONCRETE COVER P4 TELSTRA CLASS A | | |
| DRAWING No: | 521250 | REV | 0 |
| PROJECT / CATALOGUE CODE: | 521250 | PAGE: | 1 / 1 |
| | | SHEET: | A3 |
| | | SCALE UNO: | 1:5 |