

## **CONCRETE NOTE:**

- 1. REFER TO GENERAL TOLERANCES UNO
- 2. STEEL & FIBRE REINFORCED CONCRETE 40MPA
- 3. ALL LIFTING POINTS TO BE USED WHEN LIFTING
- 4. MINIMUM STRENGTH OF CONCRETE SHALL BE 25MPA AT THE TIME OF LIFTING
- 5. REFER TO BVCI-INS-C-001 (STD INSTALLATION GUIDE) FOR INSTALLATION DETAILS
- 6. REFER TO ANCON LIFTING ARRANGEMENT PLAN


	BOM:207221						
ITEM #	QTY.	PART #	DESCRIPTION	WEIGHT			
1	1	50201551	PIT CONCRETE 450x450x450x100mm CLASS D	312.14			
2	4	50201274	FOOT ANCHOR ZP 1.3Tx65mm	0			


DOM. F0301 FF1

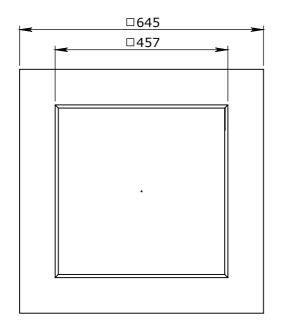


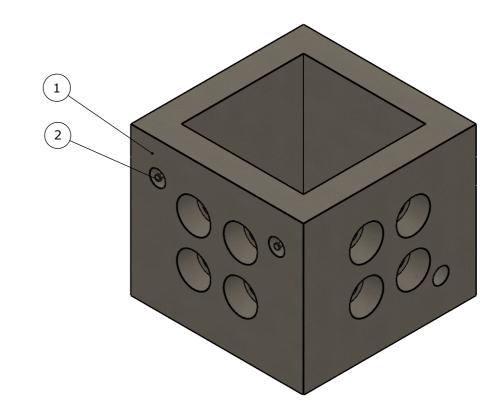

**PLAN VIEW** 

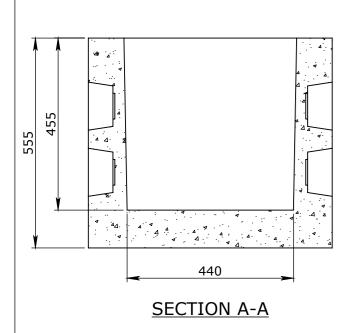

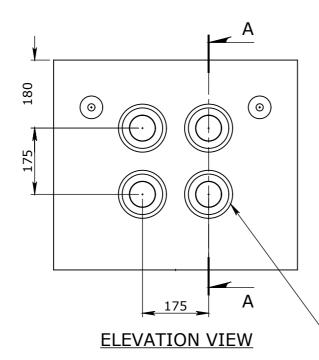

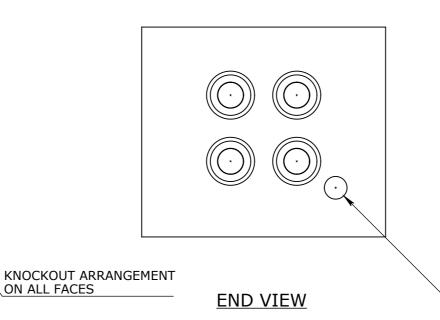

1X ∅60 DRAIN HOLE (LOCATED ON BOTTOM CORNER

**ISOMETRIC VIEW** 

TOLERANCE:

TOLERANCE NOTES:

1. CONCRETE TOLERANCES TO BE INCONJUCTION / ACCORDANCE WITH AS3600 - CONCRETE STRUCTURES

2. WHEN A BROOM FINISH IS REQUIRED THE GENERAL TOLERANCE SUPERCEDES THE FLATNESS TOLERANCE

3. WALL THICKNESS - DIMENSION AS NOTED IS MINIMUM THICKNESS ONLY

4. CONCRETE GRADE - 40MPA UNLESS NOTED OTHERWISE

5. DIMENSIONS ARE NOT INCLUSIVE OF SEALANTS OF JOINTS

6. SURFACE FINISH - CLASS 4 (AS3610.1)

l	3								CH
	2								DA
	1								]] o
	Rev.	DESCR	IPTION			DATE	BY	APPROVED	RPE
GENERAL TOLERANCES REVISION CONTROL									
	NOM	IINAL:	UP TO 1000mm	1M AND	ABOVE	FLATI	NESS: (NOT INCLUI	DING BROOME FINISH)	WE

1mm IN 200mm UP TO

A MAXIMUM OF 20mm

C.All 01/06/2018 PEQ DOCUMENT # 312.14Kg MATERIA ±4mm PER 1M WIDTH CONCRETE 40MPA

## Infrastructure Products Australia

A CRH COMPANY

91 STRADBROKE STREET 1 REEVES COURT BREAKWATER, VIC 3219 HEATHWOOD, QLD 4110

DRAFTED DATE:	PART/PRODUCT #	QUO	TE#	ORDER ;	ŧ	
21/02/2018						
DRAFTED BY:	REINFORCEMENT COMPUTATION	CEMENT COMPUTATION PIT #		ITEM TYPE		
DATE LAST SAVED: CLIENT						
29/09/2022						
LAST SAVED BY:	PROJECT DESC					
NBRADIC						
⊕€-	DRAWING NAME 450x450 PIT WITH KNOCKOUTS					
DRAWN TO AS 1100	DRAWING #	PAGE	SHEET SIZE	SCALE		
DO NOT SCALE FROM SHEET	50201551	1/1	A3	1:10		

IN 1M LENGTH

ON ALL FACES