GENERAL NOTES:

5.

6

- CONCRETE GRADE TO BE 50 MPA MINIMUM 1. 2.
- DESIGN LIFE OF 50 YEARS MINIMUM EXPOSURE CLASSIFICATION - B2 MINIMUM COVER TO REINFORCEMENT - 40mm
- 3. DESIGN LIFE OF 100 YEARS MINIMUM EXPOSURE CLASSIFICATION - B1 MINIMUM COVER TO REINFORCEMENT - 40mm
- DESIGN CAPACITY OF PITS WITH CLASS L REINFORCEMENT 4. HAS BEEN REDUCED 20%
- ALLOWABLE SOIL BEARING PRESSURE IS 100KPA 5.
- 6. TOP REBATE TO SUIT RISER SHALL BE ACCORDING TO THE PIT ASSEMBLY DRAWINGS


3


2

1


		BOM:
ITEM #	QTY.	DESC
1	1	CORBEL WITH REE
2	2	FOOT ANCHOR 1.3

9

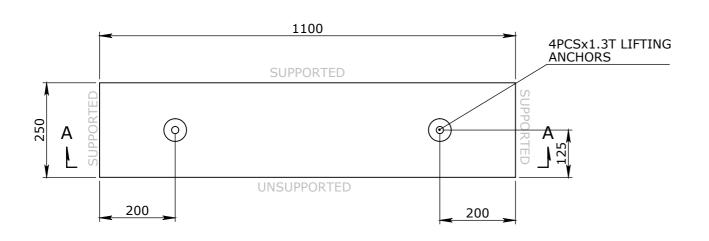

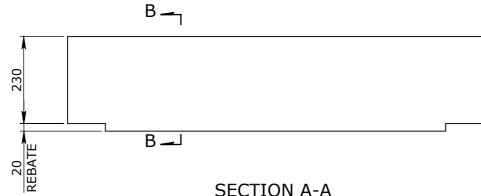


RAFTED DAT CHK / APPR С 30/06/2020 REINFORCEMENT COMPUTATION DATE: DRAFTED B MLEE DATE LAST SAVED RPEQ DOCUMENT #: DATE BY APPROVED 1/1 REEVES COURT, BREAKWATER, VIC 3219 24/08/2020 REVISION CONTROL P: (03) 5222 4526; F: (03) 5222 1914 LAST SAVED BY MLEE WEIGHT

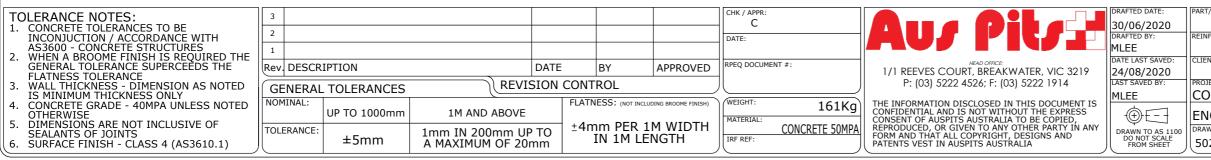

SECTION A-A

PLAN VIEW

SECTION B-B

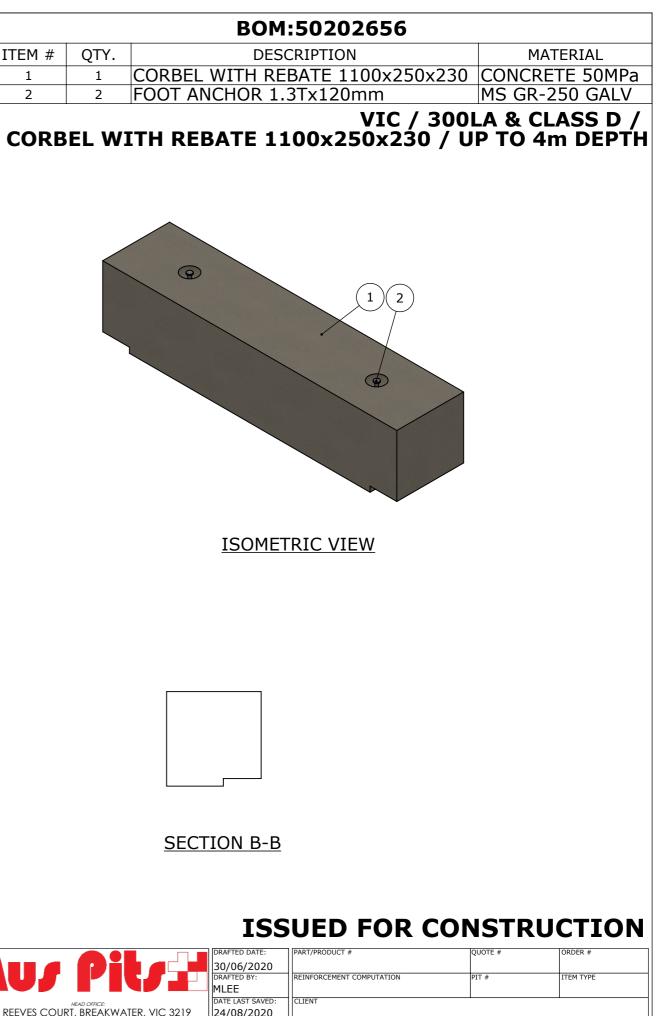

	CORBEL (VIC - 300LA 8	LASS	D)			
	ENGINEERING COMPUT	REV.				
	DRAWING #	PAGE	SHEET SIZE	SCALE		
J	50202656	1/1	A3	1:10		