






LAST SAVED BY: NBRADIC ON THURSDAY, 30 MAY 2023 13:50:05 AEST (AEST)

CONCRETE PRODUCT NOTE:

1. REFER TO GENERAL TOLERANCES UNO
2. GRADE OF CONCRETE - PIT: CONCRETE FIBRE 40MPA / TURRET: CONCRETE 40MPA
3. ALL LIFTING POINTS TO BE USED WHEN LIFTING
4. MINIMUM STRENGTH OF CONCRETE SHALL BE 25MPa AT THE TIME OF LIFTING
5. COVER TO REINFORCEMENT TO BE 50mm
6. REFER TO ANCON LIFTING ARRANGEMENT PLAN

BOM:50201473-01

ITEM #	QTY.	PART #	DESCRIPTION	VOLUME
1	1	50201473		1.64
2	1	50201048	FERRULE ZP M12x50 C/W 10mm HOLE	0.12

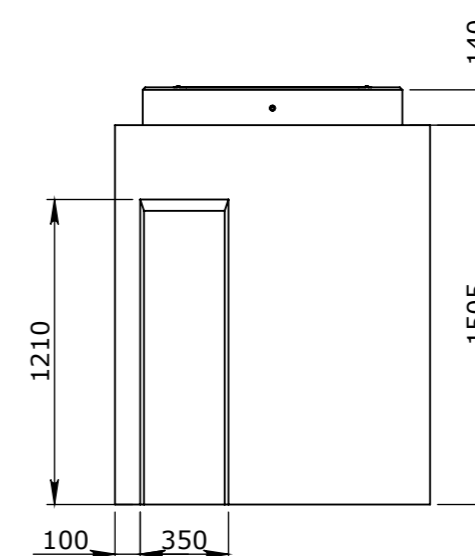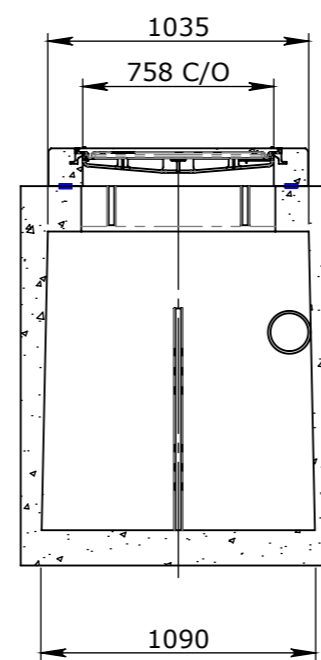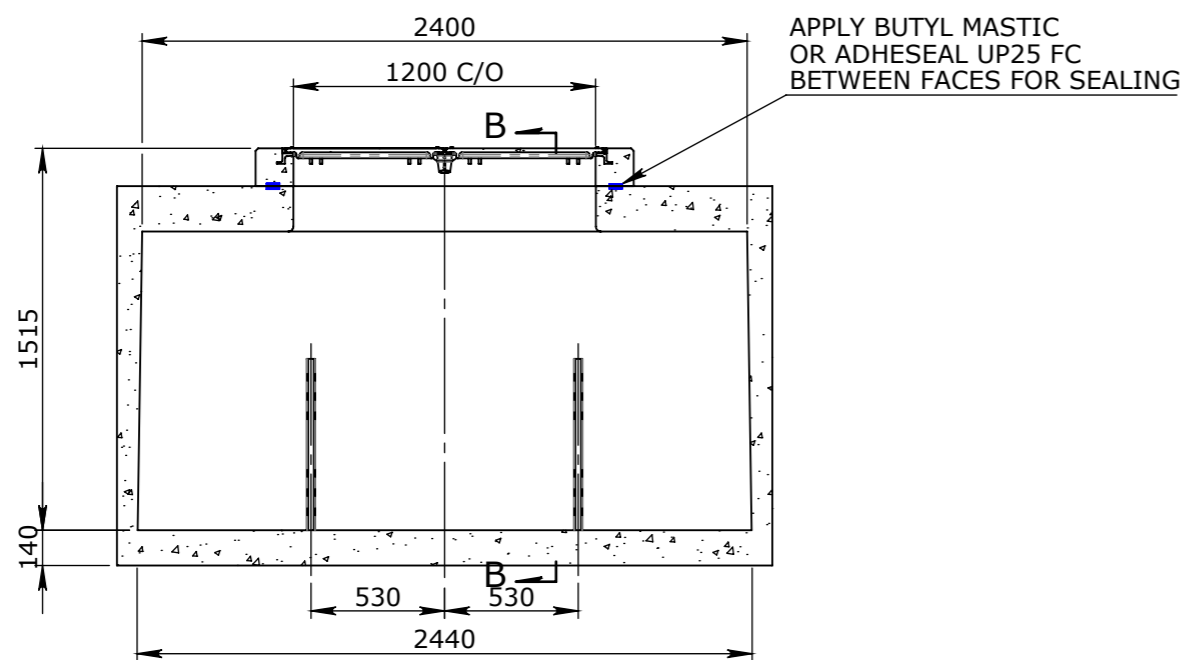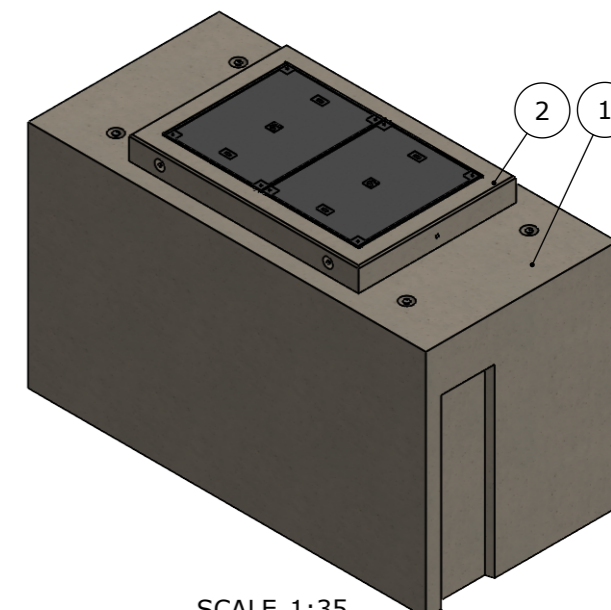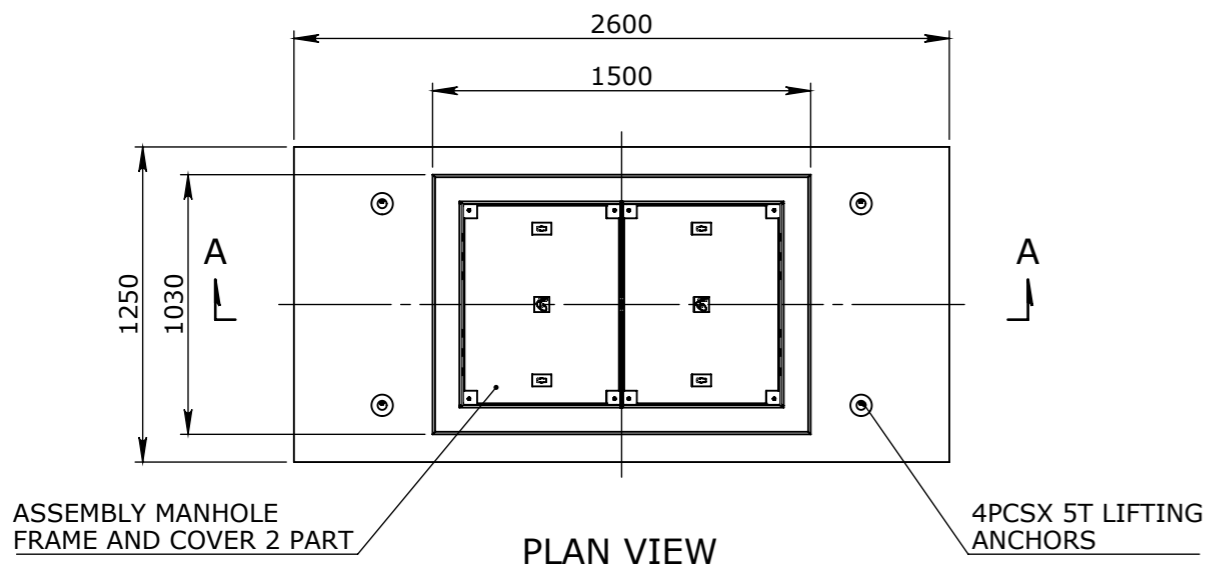

UNCONTROLLED DOCUMENT WHEN PRINTED

- TOLERANCE NOTES:**
1. CONCRETE TOLERANCES TO BE IN CONJUNCTION / ACCORDANCE WITH AS3600 - CONCRETE STRUCTURES
 2. WHEN A BROOM FINISH IS REQUIRED THE GENERAL TOLERANCE SUPERCEDES THE FLATNESS TOLERANCE
 3. WALL THICKNESS - DIMENSION AS NOTED IS MINIMUM THICKNESS ONLY
 4. CONCRETE GRADE - 40MPA UNLESS NOTED OTHERWISE
 5. DIMENSIONS ARE NOT INCLUSIVE OF SEALANTS OF JOINTS
 6. SURFACE FINISH - CLASS 4 (AS3610.1)

Rev	DESCRIPTION	DATE	BY	APPROVED
3				
2				
1				

GENERAL TOLERANCES		REVISION CONTROL	
NOMINAL:	UP TO 1000mm	1M AND ABOVE	FLATNESS: (NOT INCLUDING BROOME FINISH)
TOLERANCE:	±5mm	1mm IN 200mm UP TO A MAXIMUM OF 20mm	±4mm PER 1M WIDTH MAX IN 1M LENGTH

CHK / APPR:	
DATE:	
RPEQ DOCUMENT #:	
WEIGHT:	4318.8Kg
MATERIAL:	<NOT SPECIFIED>
IRF REF:	

Infrastructure Products Australia
A CRH COMPANY

HEAD OFFICE:
1 REEVES COURT
BREAKWATER, VIC 3219
1800 065 356

ENGINEERING & DEVELOPMENT:
91 STRADBROKE STREET
HEATHWOOD, QLD 4110
(07) 3714 0444

DRAFTED DATE:	11/07/2022
DRAFTED BY:	NBRADIC
DATE LAST SAVED:	30/05/2023
LAST SAVED BY:	NBRADIC
DRAWN TO AS 1100	DO NOT SCALE FROM SHEET

PART/PRODUCT #	50201473-01	QUOTE #		ORDER #	
REINFORCEMENT COMPUTATION		PIT #		ITEM TYPE	
CLIENT	CUBIS SYSTEMS/AUSPITS				
PROJECT DESC	CATALOGUE ITEM				
DRAWING NAME	PIT CONCRETE MANHOLE PF4 WITH FLOOR				
DRAWING #	50201473-01	PAGE	1 / 1	SHEET SIZE	A3
SCALE	1:30	REV.	0		