




- CONCRETE NOTE:
1. REFER TO GENERAL TOLERANCES UNO
  2. GRADE OF CONCRETE - 40MPa FIBRE CONCRETE
  3. ALL LIFTING POINTS TO BE USED WHEN LIFTING
  4. MINIMUM STRENGTH OF CONCRETE SHALL BE 25MPa AT THE TIME OF LIFTING
  5. REFER TO PRECAST CONCRETE INSTALLATION GUIDE V.1 2019 FOR INSTALLATION DETAILS
  6. REFER TO ANCON LIFTING ARRANGEMENT PLAN

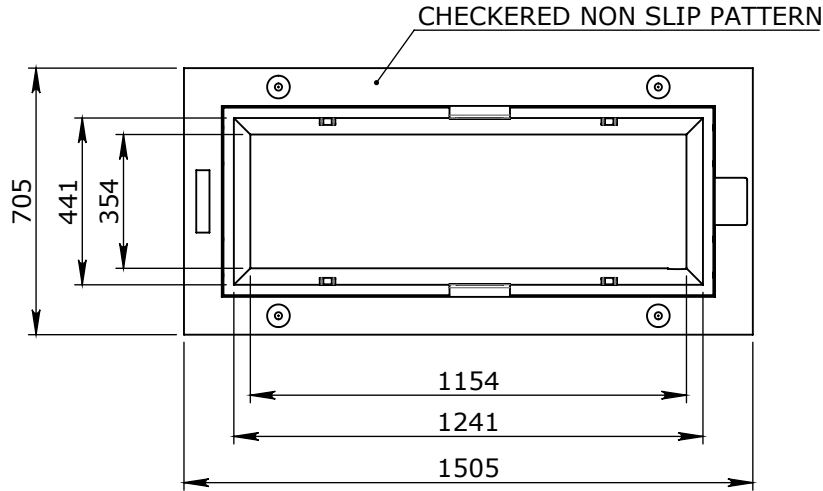


PLAN VIEW

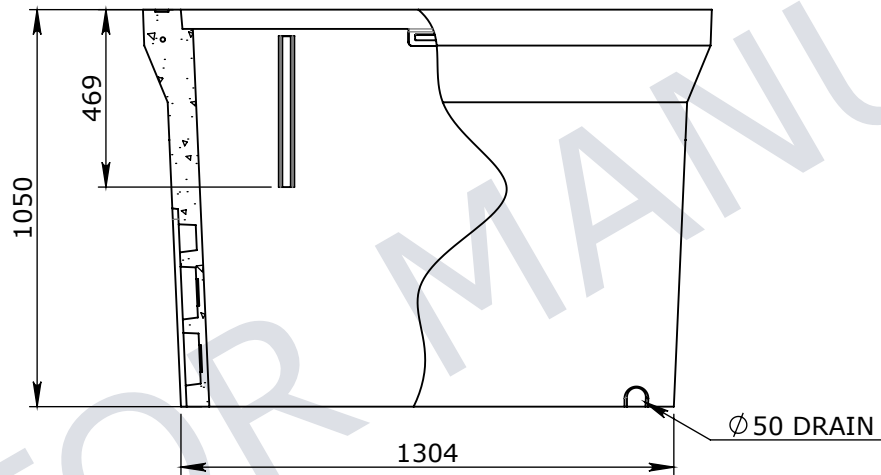

ELEVATION VIEW

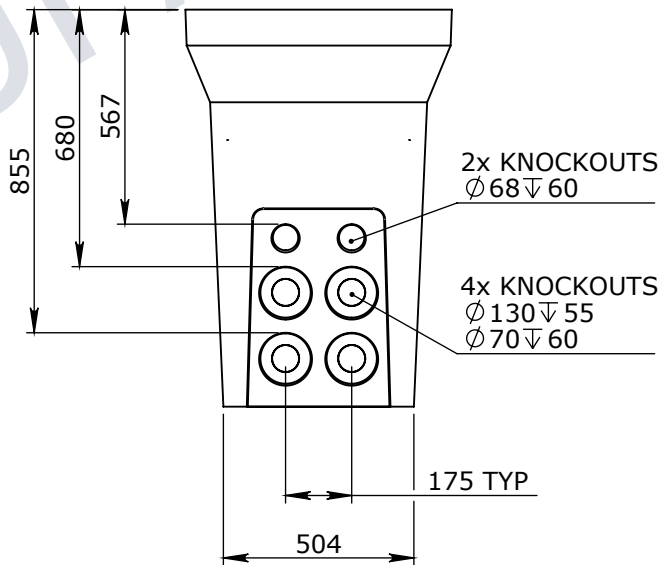

END VIEW

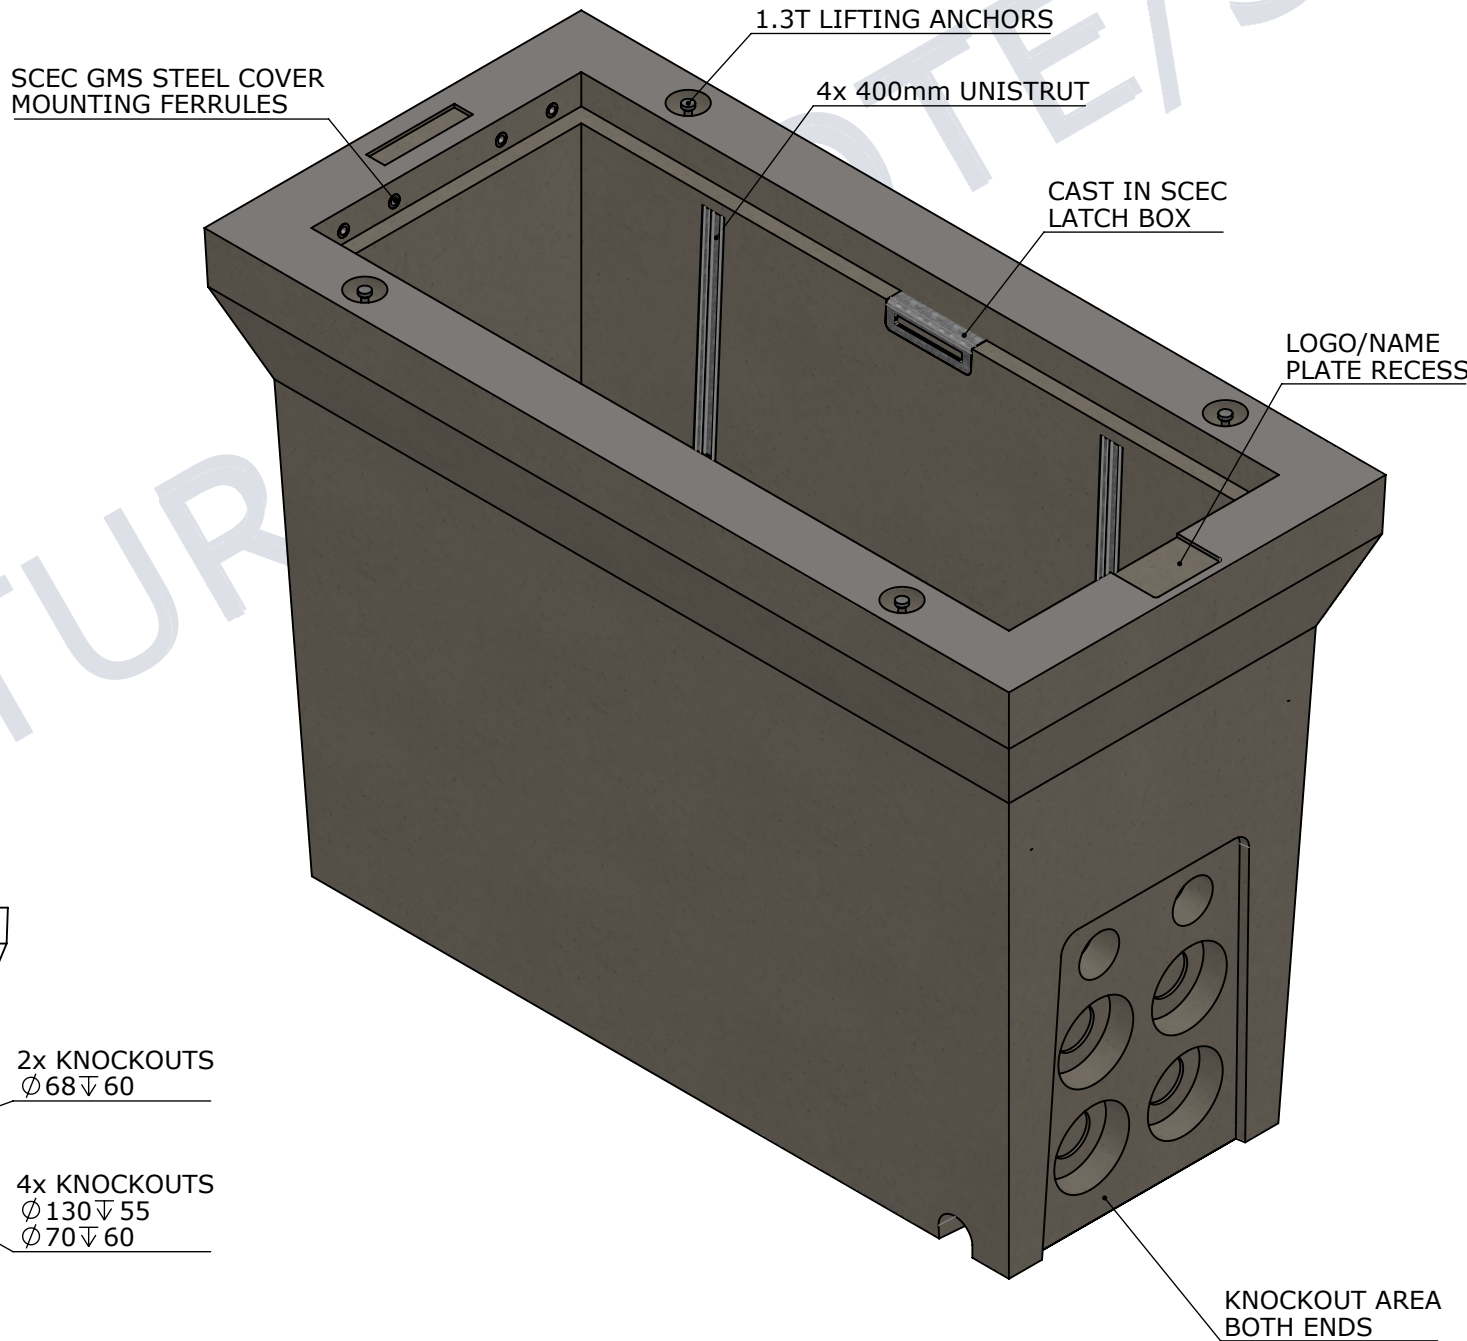

ISOMETRIC VIEW

SCALE 1:10

UNCONTROLLED DOCUMENT WHEN PRINTED

- TOLERANCE NOTES:
1. CONCRETE TOLERANCES TO BE INCONJUNCTION / ACCORDANCE WITH AS3600 - CONCRETE STRUCTURES
  2. WHEN A BROOM FINISH IS REQUIRED THE GENERAL TOLERANCE SUPERCEDES THE FLATNESS TOLERANCE
  3. WALL THICKNESS - DIMENSION AS NOTED IS MINIMUM THICKNESS ONLY
  4. CONCRETE GRADE - 40MPa UNLESS NOTED OTHERWISE
  5. DIMENSIONS ARE NOT INCLUSIVE OF SEALANTS OF JOINTS
  6. SURFACE FINISH - CLASS 4 (AS3610.1)

3	ENGINEERING CHANGE EC 0001	19-01-2024		
2	INCREASED INTERNAL HEIGHT TO 1050mm	15/08/22	PA	
1				
Rev.	DESCRIPTION	DATE	BY	APPROVED
GENERAL TOLERANCES				
NOMINAL:	UP TO 1000mm	1M AND ABOVE	FLATNESS: (NOT INCLUDING BROOME FINISH)	
TOLERANCE:	±5mm	1mm IN 200mm UP TO A MAXIMUM OF 20mm	±4mm PER 1M WIDTH IN 1M LENGTH	

CHK / APPR:	Thilini Mendis
DATE:	13-01-2020
RPEQ DOCUMENT #:	
WEIGHT:	730Kg
MATERIAL:	CONCRETE FIBRE 40MPa
IRF REF:	

Infrastructure Products Australia

A CRH COMPANY

HEAD OFFICE:

1 REEVES COURT  
BREAKWATER, VIC 3219  
1800 065 356

ENGINEERING & DEVELOPMENT:

91 STRADBROKE STREET  
HEATHWOOD, QLD 4110  
(07) 3714 0444

DRAFTED DATE:	28/05/2019
DRAFTED BY:	P.ADAMS
DATE LAST SAVED:	30/01/2024
LAST SAVED BY:	TMENDIS
DRAWN TO AS 1100 DO NOT SCALE FROM SHEET	

PART/PRODUCT #	50201529	QUOTE #		ORDER #	
REINFORCEMENT COMPUTATION		PIT #		ITEM TYPE	
CLIENT	CUBIS SYSTEMS AUSTRALIA				
PROJECT DESC	BELLTOP 8 NO FLOOR CLASS D				
DRAWING NAME	PIT CONCRETE BELLTOP 8 NO FLOOR CLASS D				
DRAWING #	50201529	PAGE	1 / 1	SHEET SIZE	A3
SCALE	1:20	REV.	2		